# CBX - CONNECTION BOX FOR TTC AND VTD




A4x405 = Valve actuator on/off A40405/A41405
XPIR = Externa occupancy detector
CBFS, CBFE = Fan coil unit control box
CBR, CBRE = Relay box for lighting
GTQD/V = Carbon dioxide sensor; Duct/V(Wall)
GFI* = External airflow sensor with actuator
TTC = Active roof mounted supply air diffuser
VTD = Active wall mounted supply air diffuser
APR 40405/AA5004 = Valve actuator 0-10V

Note*:
GFI/DCV-SL is substituted for DCV-BL.

Note**:
A jumper on the connected active diffuser PCB decides. See JP15 for TD11&TD20 and JP4 for TD30.

**AIN1/NÄRV: Used for eighter AIN1 or PIR.

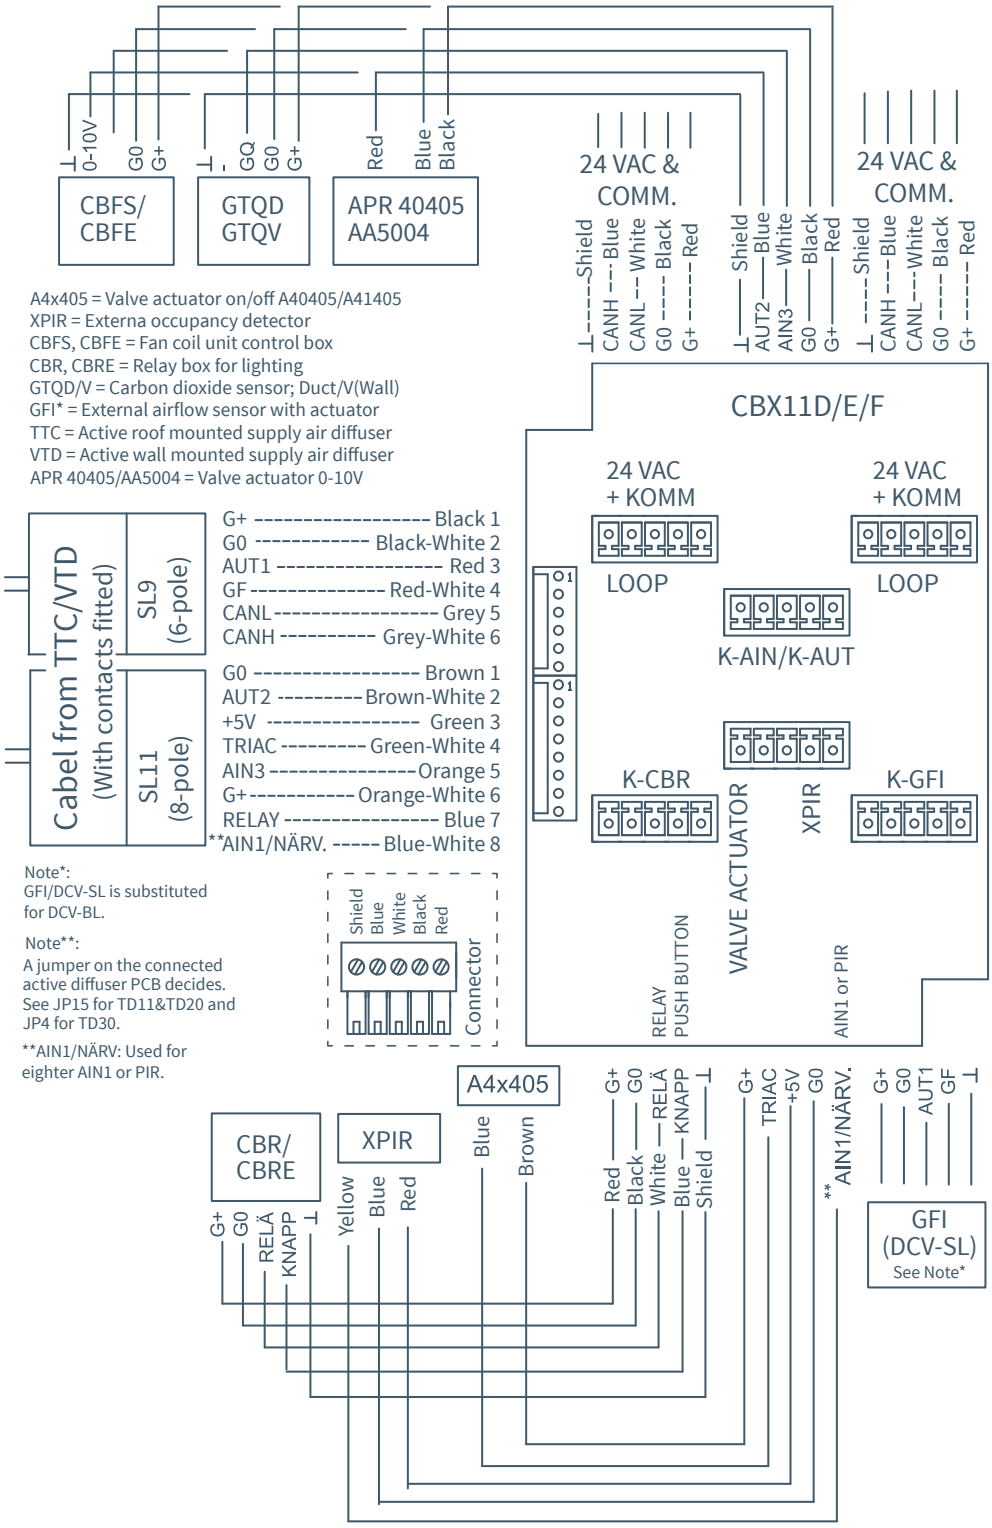

LINDINVENT